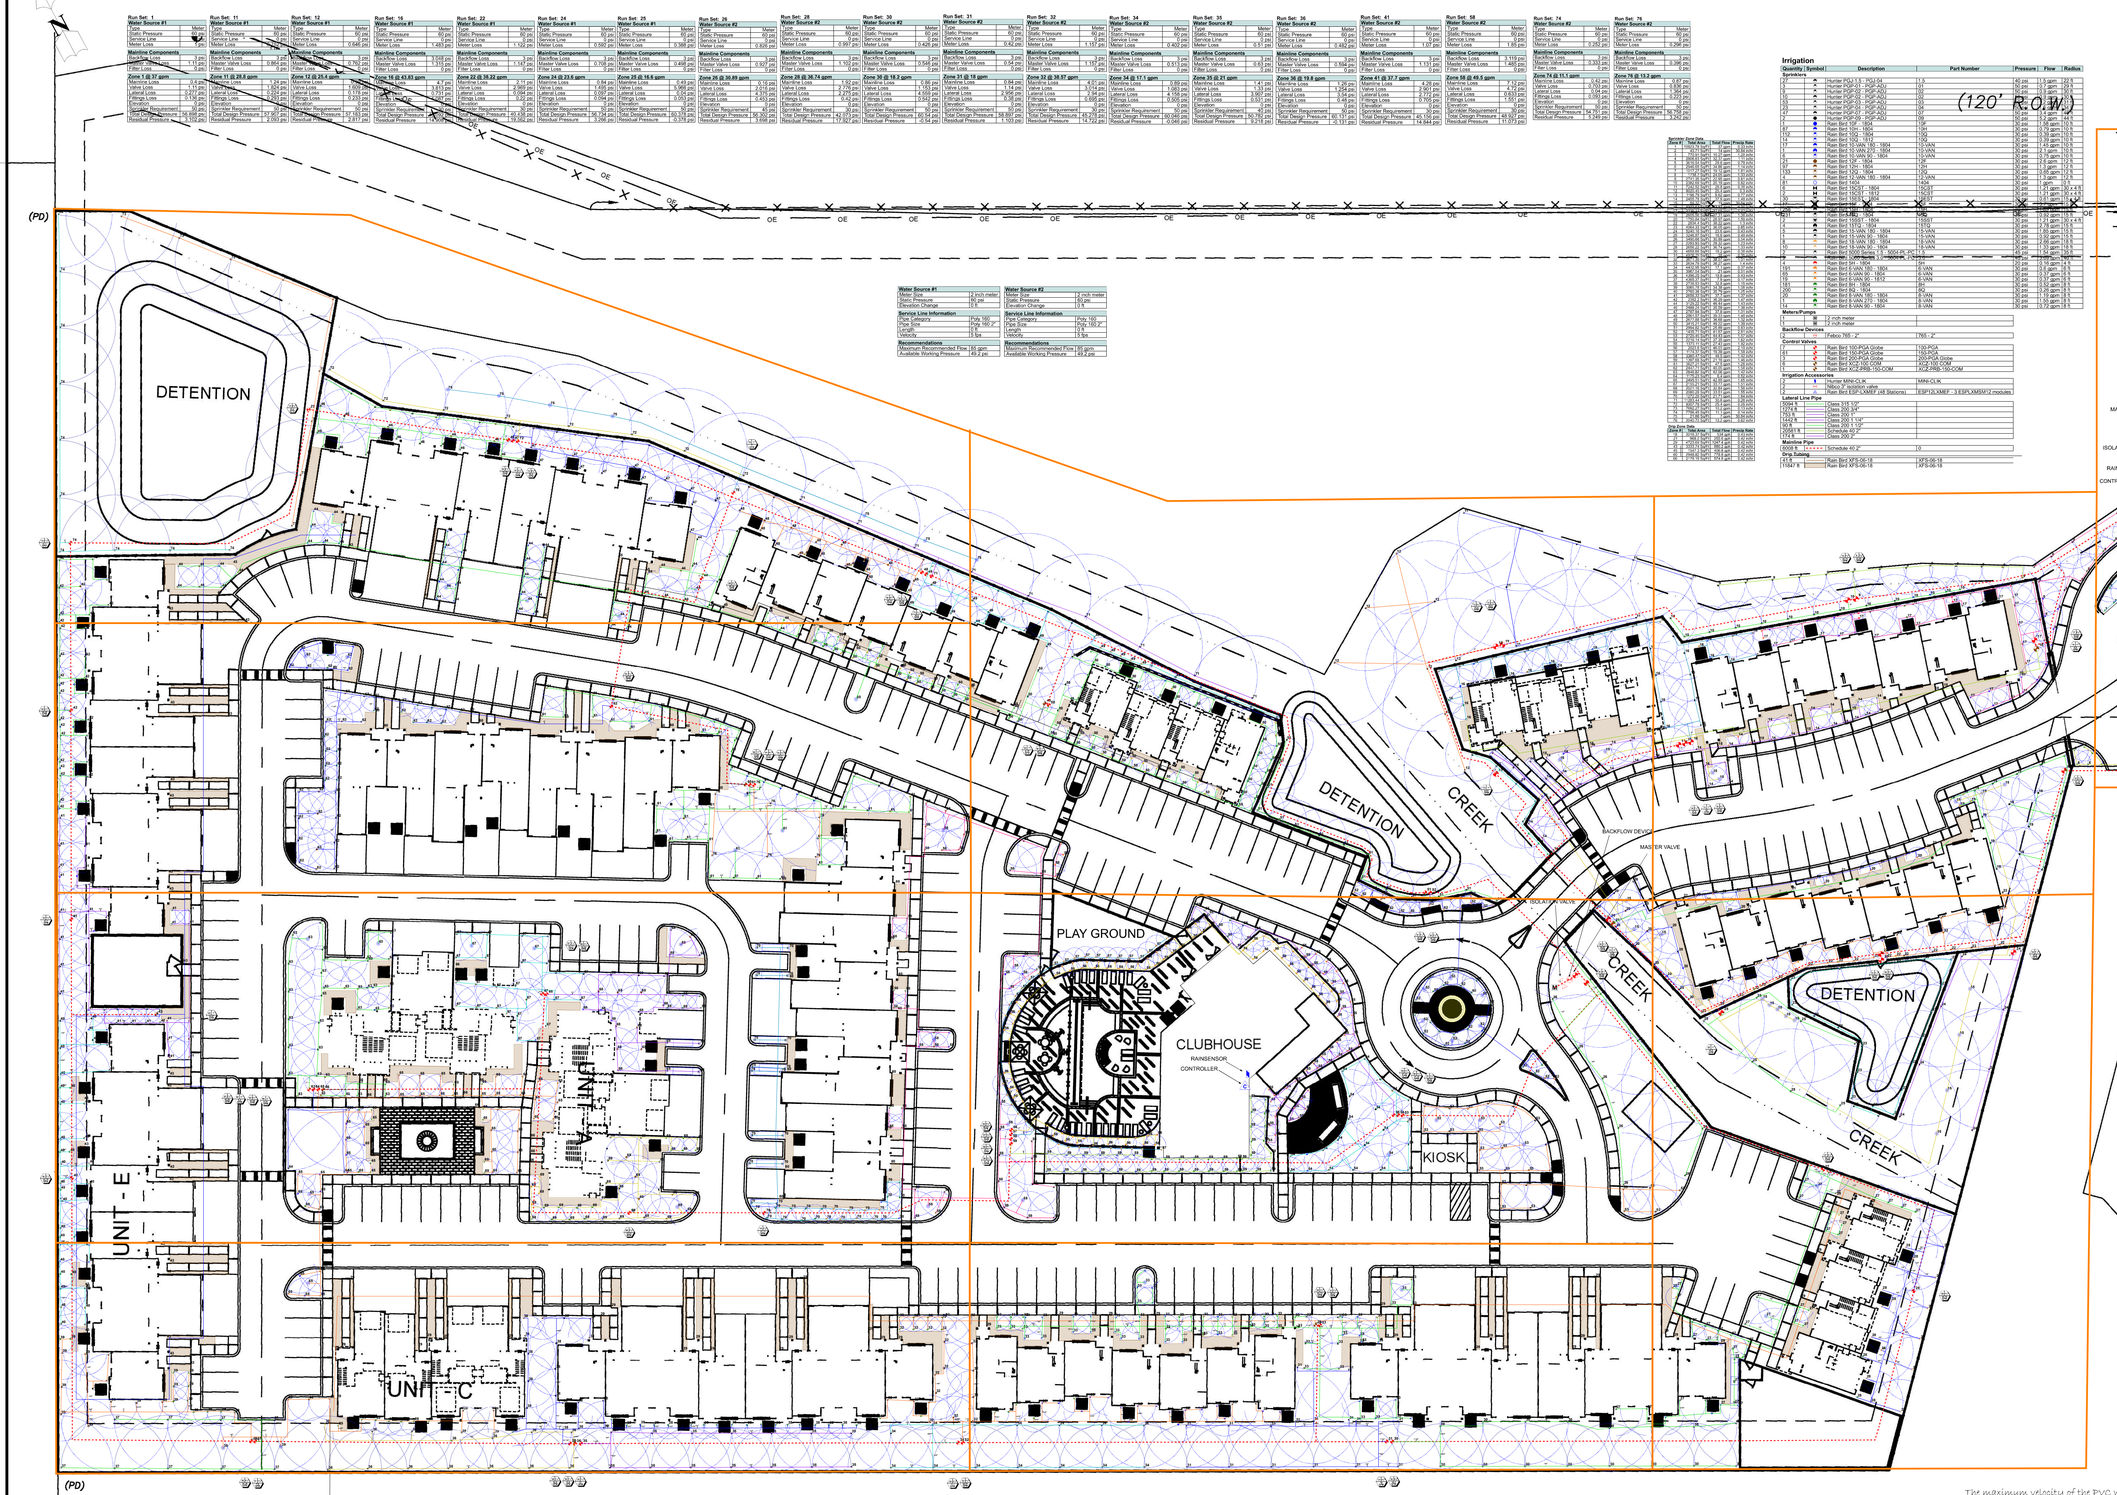

SHEET DESCRIPTION:
IRRIGATION DESIGN

PROJECT:
PANTHER VIEW TOWNHOMES
PRAIRIE VIEW, TX

EXISTING SEWER FORCEMAIN

TEXAS IRRIGATION DESIGN & Lighting
281-541-0499

STATE OF TEXAS
CASEY L. REIMANN
14897
LICENSED IRRIGATOR

Casey Reimann
03/02/2020

REVISIONS:
None

DATE:
03/02/2020

JOB NUMBER:
D1-03022020

DRAWN BY:
CASEY REIMANN

CHECKED BY:
CLR

SCALE:
1" = 40'

SHEET:
L3.0

The maximum velocity of the PVC water piping will not exceed 5 linear feet per second.
Plans and instruction manuals will be kept on site during the installation of the system.
Proposed watering schedule will be programmed into controller.
There will be a permanent sticker on controller.
Wiring used to connect controller is U.L. approved.
Irrigation in Texas is regulated by the Texas Commission on Environmental Quality (TCEQ) (MC-178).
PO Box 13087, Austin, Texas 78711-3087.
TCEQ's website is:
www.tceq.state.tx.us.
Backflow preventer will need to be tested yearly.

0 20 40 80
1" = 40'